
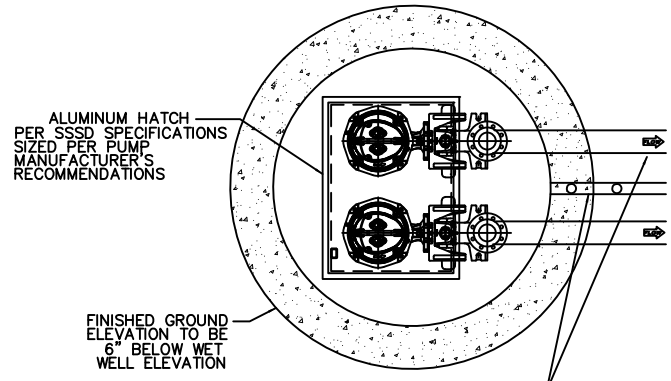


CONSTRUCTION DETAIL NO. 24b

- NOTE:**
1. SEE DETAIL SHEETS FOR HATCH DETAILS.
 2. INSTALL 4" COMPACTED CRUSHER RUN OVER ALL AREAS OF DISTURBED EARTH. INSTALL 2" WASHED STONE IN VICINITY OF WET WELL AND VAULT TO PROVIDE DRAINAGE DURING WASHDOWN.

NOTE: VERIFY ALL ELEVATIONS PRIOR TO FABRICATION

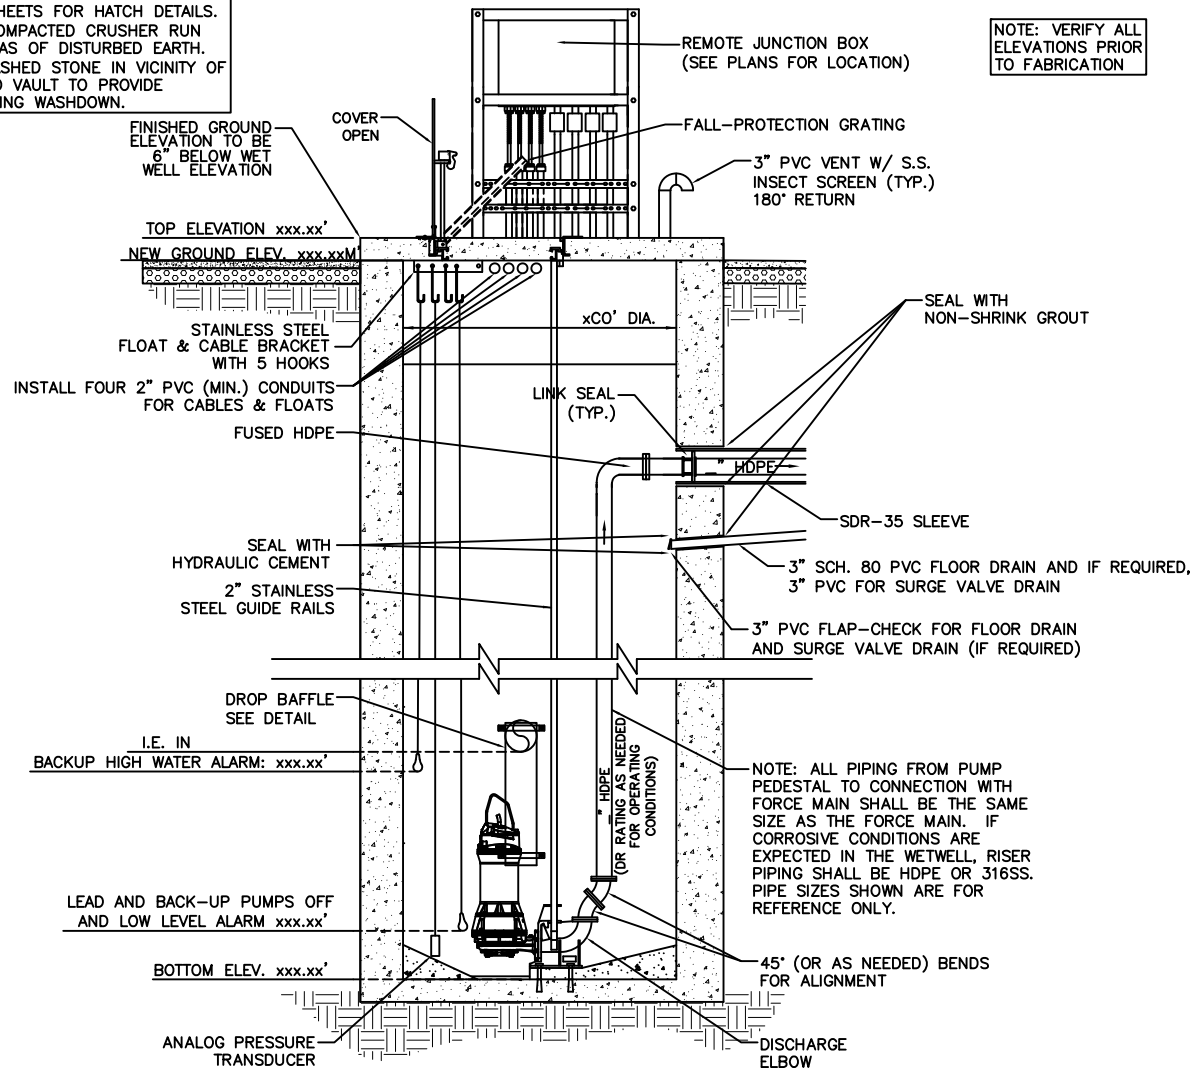

INSTALL (2) 3" SCH. 80 PVC DRAIN AND 3" PVC FLAP-CHECK FOR SURGE VALVE DRAIN AND FLOOR DRAIN

WETWELL

NTS



SUBMERSIBLE PUMP STATION

SCALE: NONE REVISION DATE: 6/28/2022